

PCD7.L210 Output module with 4 triacs, 250 VAC/0.8 A

Description

The RIO module was developed as a S-Bus data node for local switching tasks. Via a DDC of the type PCDx / PCS1 outputs can be set and manual/auto function monitored. Two address switches (x1 / x10) on the front panel allow module addressing and identification. Addresses can be set between 00 and 99. Up to 100 RIO modules and a maximum of 3 PCD stations can be connected to one bus branch simultaneously. If the bus cycle time is critical, fewer than 30 slaves should be operated in one segment.

Technical data

Bus system	S-Bus
Transmission rate	1200... 38400
Transmission mode	Parity / Data
Bus length max.	1200 m (without repeater)
Nominal voltage UN	18 VDC...32 VDC / 20 VAC...28 VAC
Current consumption	<50 mA DC / <80 mA AC
Power consumption	1.2 W / 2 VA
Relative duty cycle	100 %
Reaction time	15 ms
	(from receive data to send data reaction)
Recovery time	< 200ms
Operating temperature range	0 °C... +55 °C
Storage temperature range	-25 °C...+70 °C
Protective wiring	Reverse battery protection of service voltage Reverse battery protection of supply and bus EMC according to DIN EN 61000-6-2
Output state indicator	Yellow LED
Function indicator	Green LED for bus activity
Status indicator	Red LED for bus error message
Special features	Manual control level with revertive communication via bus;

Test voltage:
Triac / bus 4000 Veff

Output side (for each output)

Turn-on voltage	24 VAC to max 250 VAC
Constant current	0.8 A per triac
Current peak	2 A/1 s

Housing

Protection class	Housing IP40 / Terminals IP20
Humidity class	F (DIN 40040)
Connection cross-section	2.5 mm ² (terminals)
Plug-in terminal	1.0 mm ² (screw-type)
Mounting position	any
Weight	95 g
Housing dimensions	W×H×D: 35 × 70 × 74 mm
Joined without spacing	After 15 modules have been joined in sequence or a maximum supply current of 2 A (AC or DC) per port on the powersupply, the external supply voltage must be reapplied.

Data transmission

All S-Bus instructions (level 1) are recognized. Instructions that have no function in the device are answered with <NAK>. The module has integral, automatic baud rate and transmission mode recognition.

"Display Output / Write Output (not for address 5 to 8)"

Address	Information	Address	Information
1	0= Status triac 1 off 1= Status triac 1 on	5	
2	0= Status triac 2 off 1= Status triac 2 on	6	
3	0= Status triac 3 off 1= Status triac 3 on	7	
4	0= Status triac 4 off 1= Status triac 4 on	8	

Channel 1 to 8 can be called together

Information
0= triac 1 switched via bus
1= triac 1 switched via manual control
0= triac 2 switched via bus
1= triac 2 switched via manual control
0= triac 3 switched via bus
1= triac 3 switched via manual control
0= triac 4 switched via bus
1= triac 4 switched via manual control

"Display/Write Output"

Adresse	Information
9	0= Initial State relay 1
off 5	0= Zustand Kanal 1 nach Businfo
	1= Initial State relay 1

"Display Register"

Address	Information
5	Baud rate (plain text => kBit/s)
6	Module address
7	Status register
8	Bus timer
9	Current transmission mode (data / parity)
10	Bus error counter (divided into 4 bytes)

The following registers can be called together (Display Register "x" to "y") 5 to 7 / 8 to 10

"Write Register"

Address	Value	Baud rate setting (Baud kbit/s)
5	4	1 200
	5	2 400
	6	4 800
	7	9 600
	8	19 200
	9	38 400

Address	Value range	Meaning
8	2 <-> 20	20 <-> 200 ms

Bus timer (register 8)

The value displayed indicates how long the module waits until a telegram is complete. The time is shown in 10 ms steps (e.g.: value 20 => a time of 200 ms). The recommended time is 100 ms, i.e. a register value of 10. If the time is reduced, modules will react faster to telegrams from the master. If there is a heavy load on the master station, a bus timer setting that is too low may lead to lost telegrams. Times of less than 20 ms (value 2) are not permitted.

Times that reach the master station within 20 ms of the timeout will lead to lost connections. The value is stored in EEPROM and protected against voltage loss. (Factory setting : 2)

"Write Register"

Address	Value	Meaning
9	1	Parity mode
	2	Data mode (factory setting)

Address	Value	Meaning
10	0	Reset of error count register

Address	Value	Meaning
11	0	Bustimout deactivated
	1 – 255	Time in 1 second steps -> switches the outputs to switch state defined in Output 9-12, by no bus activity within the set time will be registered

"Write Output"


The write output instruction at address 255 is recognized as broadcast message. Automatic baud function: "Write or Display output 255" (1 = autobaud active / 0 = autobaud inactive)

N.B:

After a power failure, the last baud rate set will be reinstated.

For further information on the use of modules linked to S-Bus, including all restrictions, see documentation 26/339 EN

PCD7.L210 RAIL



Screw terminals, 2.5 mm², 1.0 mm² for supply voltage and bus

Mounting and commissioning to be conform with current regulations:

1. Power-off the installation
2. Place module onto 35 mm tophat rail and press down to engage.
3. Strip insulation from 7 mm of cable (max. single wire 4 mm², fine strand 2.5 mm², diameter 0.3 mm to 2.7 mm), insert into binding and tighten with a screwdriver.


Connect supply voltage and field bus to plug-in screw terminal.

Caution!!

Plug-in terminal has max. 1.0 mm² connection cross-section. Check correct connection of bus lines and supply.

Supply and Bus concept

Example with power supply PCD7.L500 with Serial S-Net connection over the terminal block and RAIL-modules with connecting of bus and supply voltage over the jumper and bus termination with PCD7.T162.

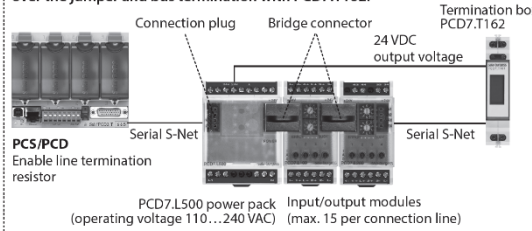

After 15 modules have been joined in sequence or a maximum supply current of 2 A (AC or DC) per port on the powersupply, the external supply voltage must be reapplied.

Operational safety:

Please take care to following points for a safety operation:

- Maximal cable length
- S-Bus member and segment division
- Potential compensation by one single grounding of power supply
- Termination of both network sides
- Cable shield grounding on one side only.

Connection example

