



Flat Nr. 0

Allen key
2.5 mm


24 V





S-Bus



Mounting Set




A

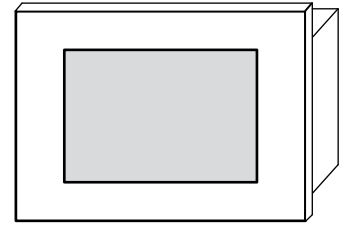


PCD7.D457ET7F (5.7")
PCD7.D410ET7F (10.4")

B

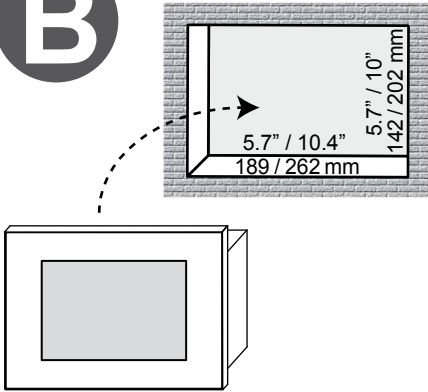

C


1

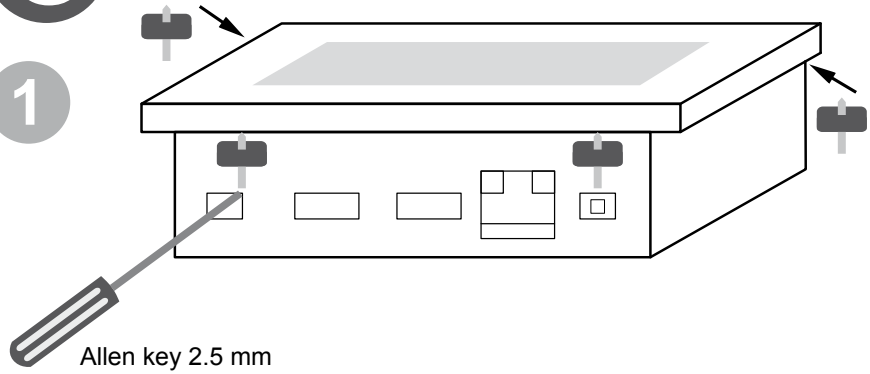

Allen key 2.5 mm


2

optional Inwall Mounting Kit
PCD7.Dxx-IWS

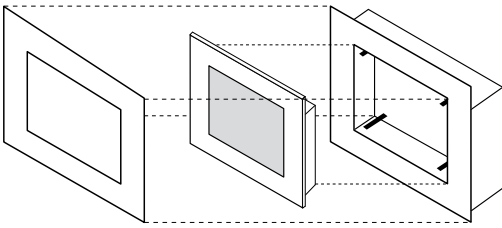


3

optional Onwall Mounting Kit
PCD7.Dxx-OWS



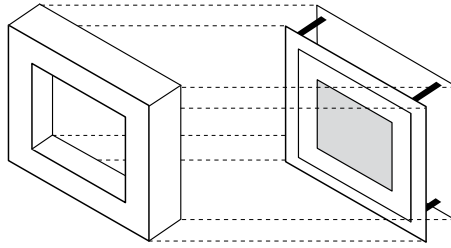


4


optional All-In-One Kit



D

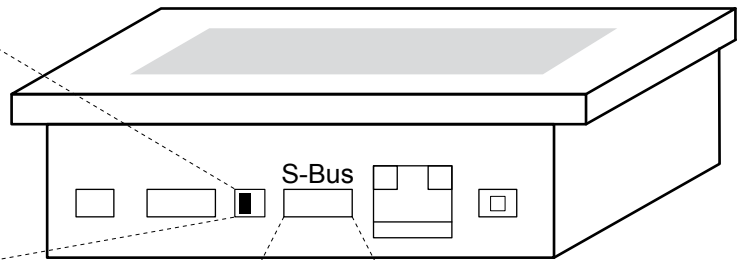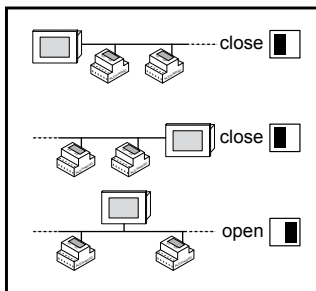


RS-485

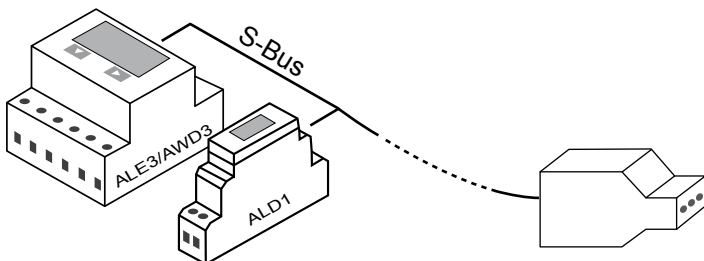


E

optional Power Supply
24 VDC 2.5 A
Q.PS-AD2-2402F


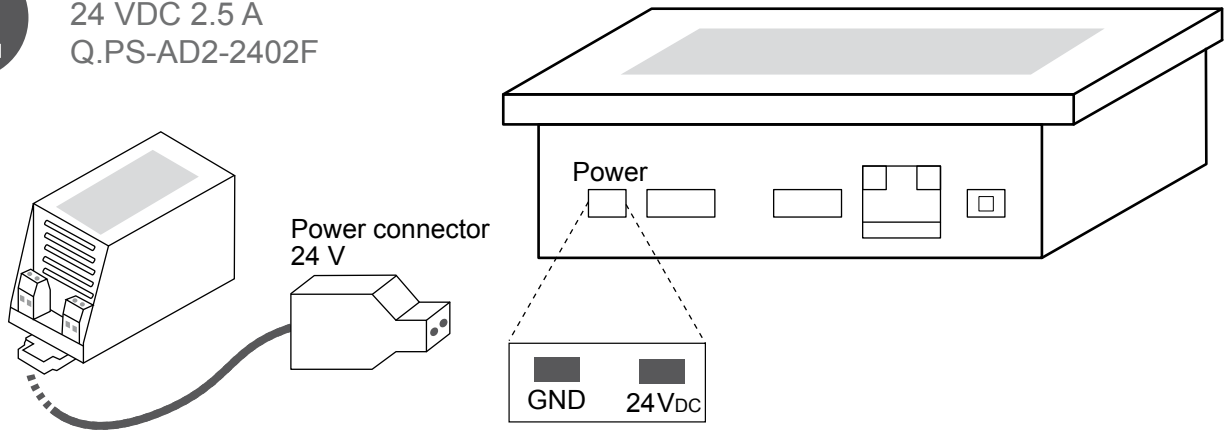


F

optional Ethernet

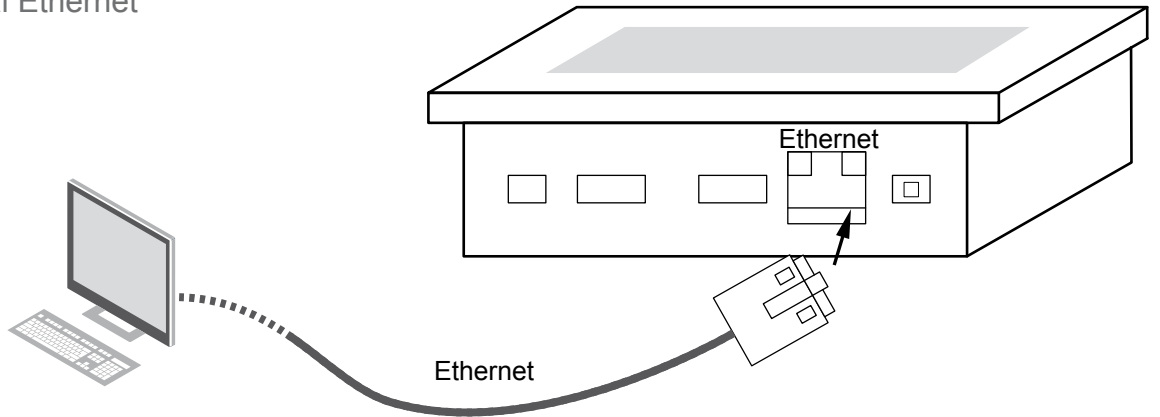

G

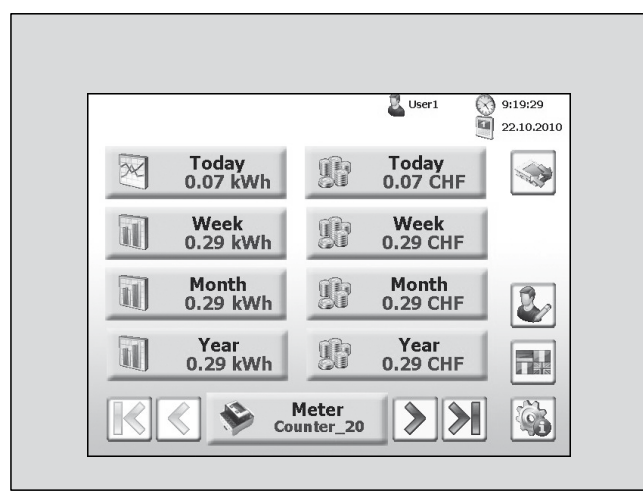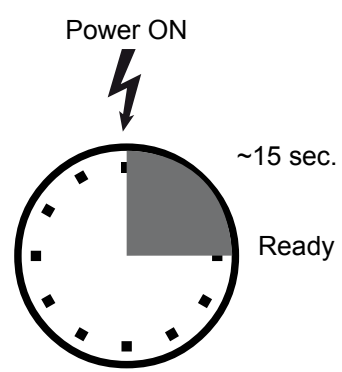


Saia-Burgess Controls AG
Bahnhofstrasse 18
3280 Murten, Switzerland
T +41 26 580 30 00
F +41 26 580 34 99
support@saia-pcd.com
www.sbc-support.com


sbc+
SAIA BURGESS CONTROLS




optional Name

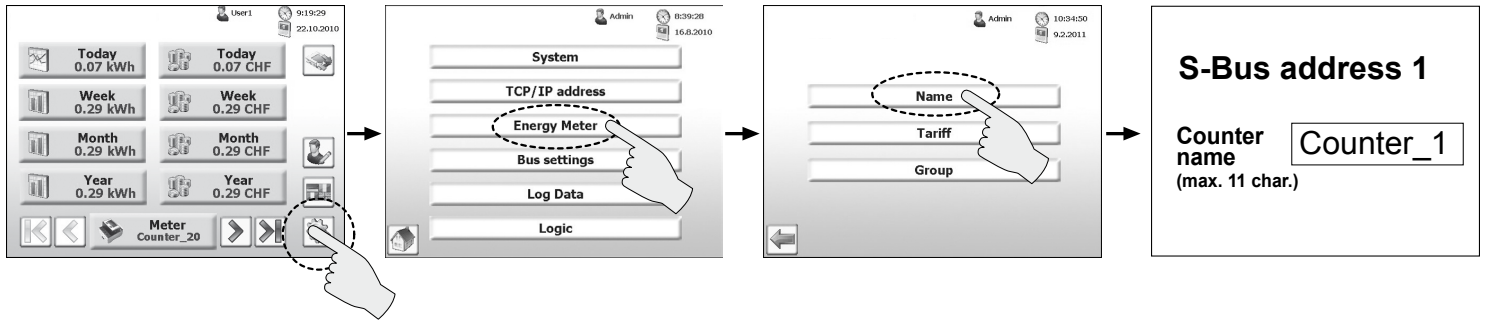


optional Tariff

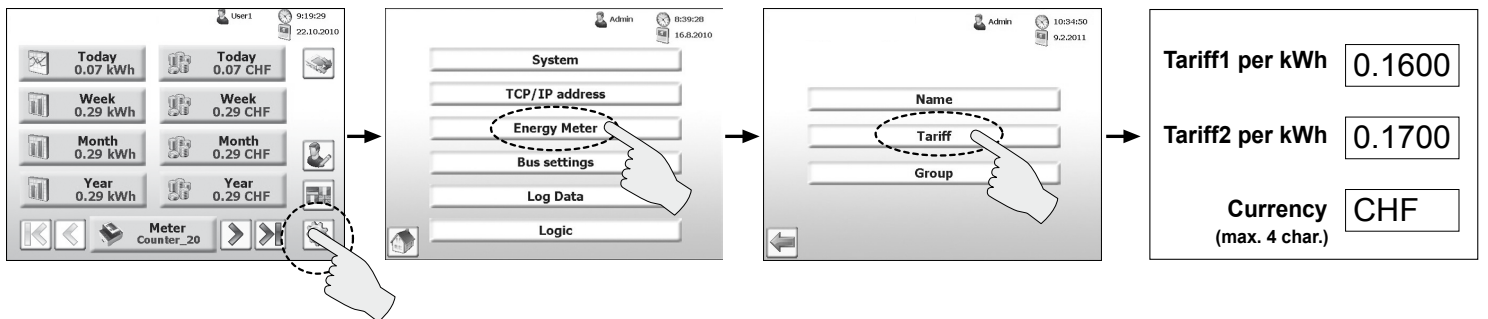

optional TCP / IP

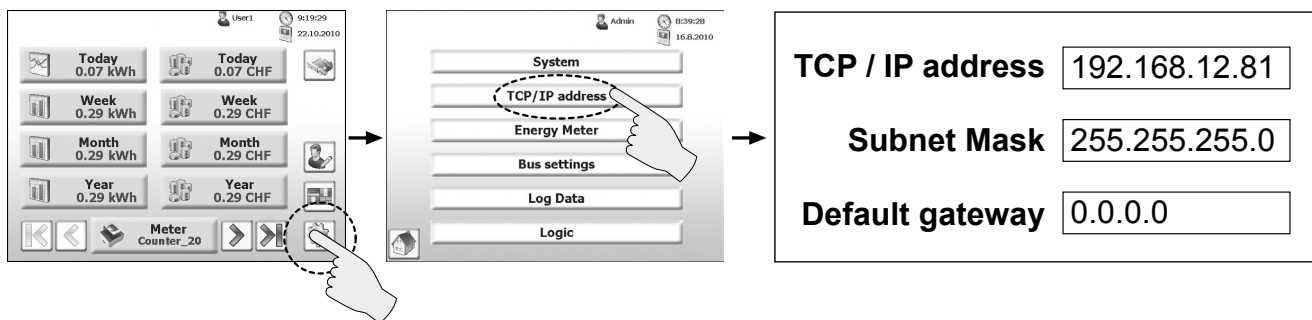


Change User

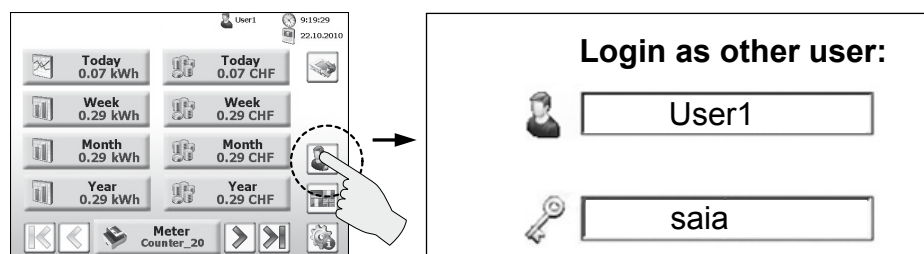

Pozi Nr. 1



Flat Nr. 0





Ø 1.5 – 16 mm²

Ø < 2.5 mm²
for Tariff E1/E2


Ø CY 0.5...0.75mm²
for S-Bus

1

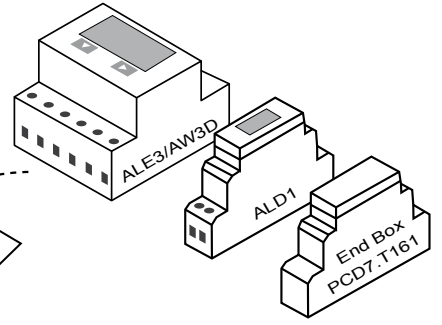


2

Install Energy Meter

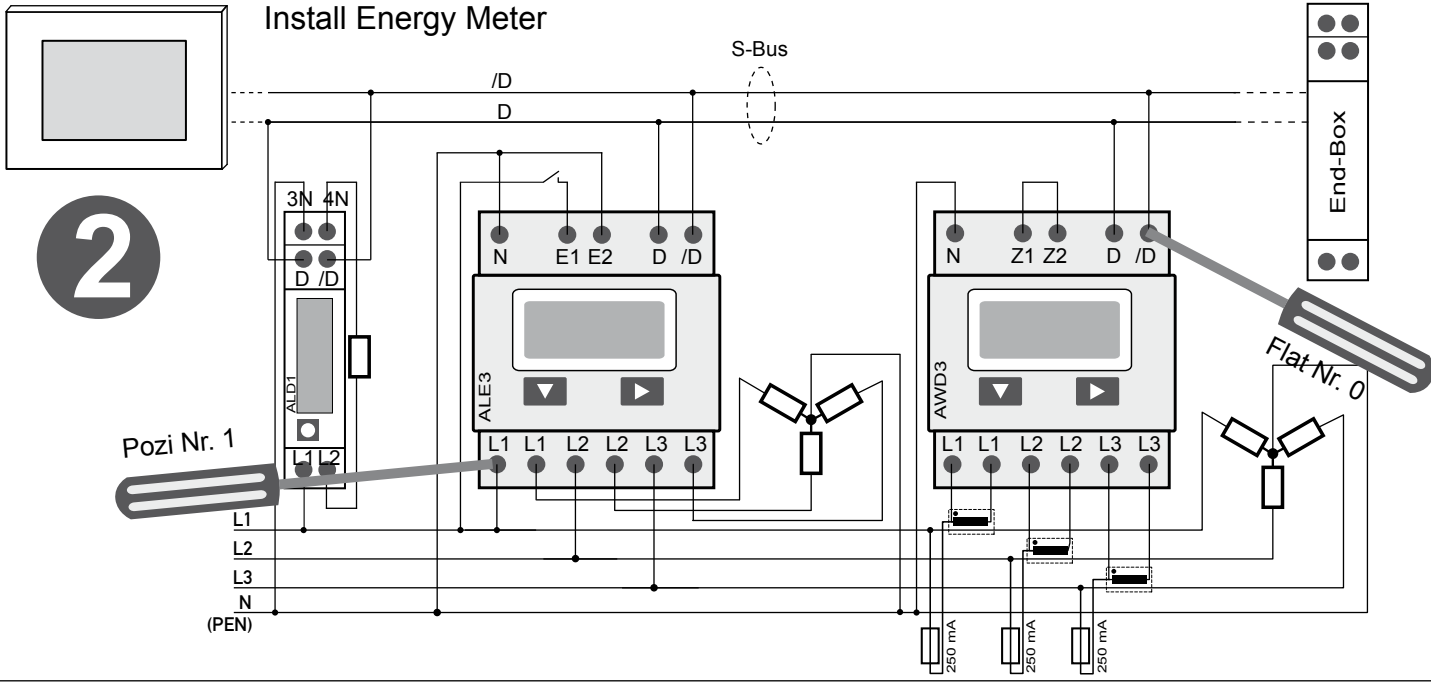


Transformer Ratio AWD3

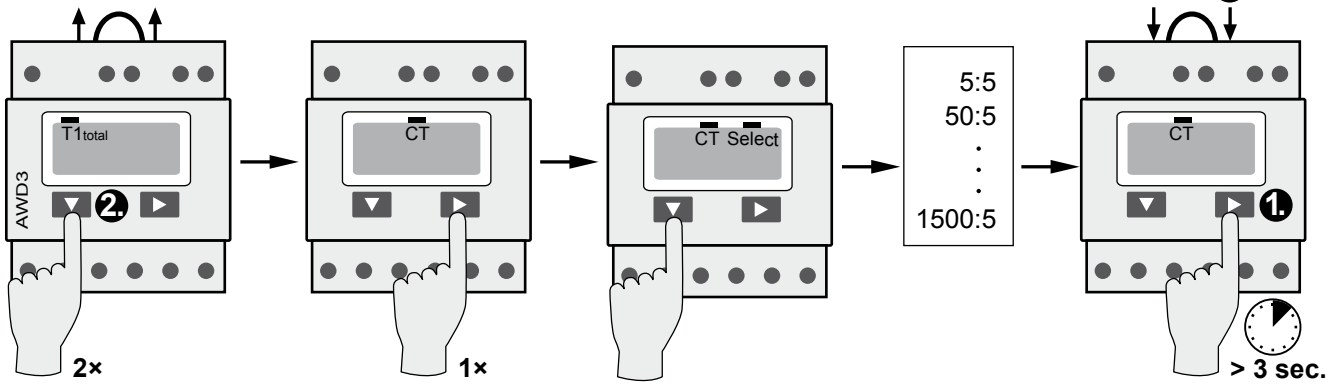


3

S-Bus address

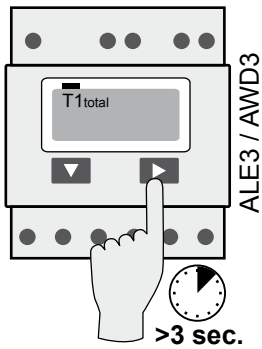

S-Bus 0...128

- ▶ +1
- ▶ +10

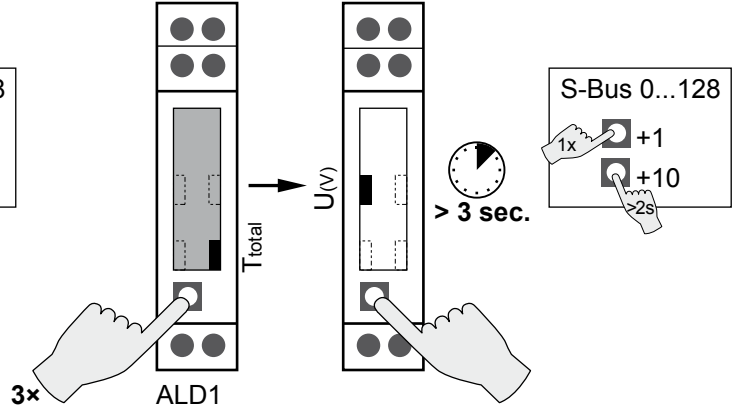

S-Bus 0...128

- ▶ +1
- ▶ +10