

- E** Leaflet
5.7" Energy Manager on-wall mounting set
- D** Beilageblatt
5.7" Energy Manager Wandmontage-Set
- F** Feuille intercalaire
Set pour montage mural Energy Manager 5.7"

Q.OWS-7DET7F-1



Bill of materials, Materialliste, Liste de materiel



E

The 5.7" Energy Manager on-wall mounting set **Q.OWS-7DET7F-1** comprises:

Quantity	Name	SBC Nr.
1	Box	410748980
1	Energy Manager 5.7"	PCD7.D457ET7F
1	Power supply 24 VDC, 2.5 A	Q.PS-AD2-2402F
1	Power cable	
1	SBus cable	
1	Grounding cable	

D

Das 5.7" Energy Manager Wandmontage-Set **Q.OWS-7DET7F-1** besteht aus:


Anzahl	Bezeichnung	SBC Nr.
1	Gehäuse	410748980
1	S-Energy Manager 5.7"	PCD7.D457ET7F
1	Netzteil 24 VDC, 2.5 A	Q.PS-AD2-2402F
1	Netz Kabel	
1	SBus Kabel	
1	Erdungskabel	

F

Le **Q.OWS-7DET7F-1** 5.7" Energy Manager set pour montage mural se compose de:

Quantité	Désignation	SBC Nr.
1	Boîtier	410748980
1	S-Energy Manager 5.7"	PCD7.D457ET7F
1	Alimentation 24 VDC, 2.5 A	Q.PS-AD2-2402F
1	Câble d'alimentation	
1	Câble SBus	
1	Câble de mise à terre	

Dimensions, Grösse, dimensions

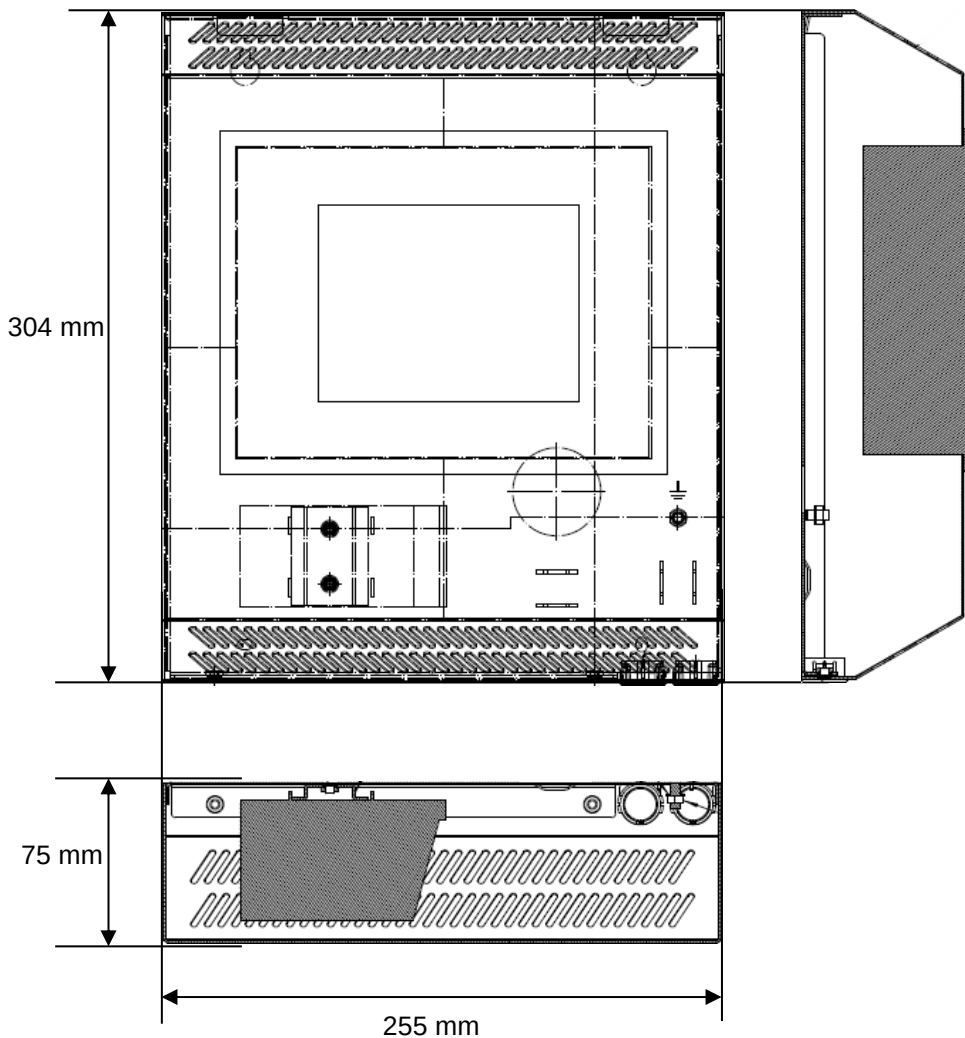

Fixing, Befestigung, fixation

Diameter of the screw, Schraubendurchmesser, diamètre de la vis:

6 mm



Diameter of the screw shank, Knopfschraubendurchmesser, diamètre de la tête de vis:

10 mm

Hole diameter for cables, Lochdurchmesser für Kabel, diamètre du trou pour les câbles :

40 mm

Drilling, Bohrung, perçage

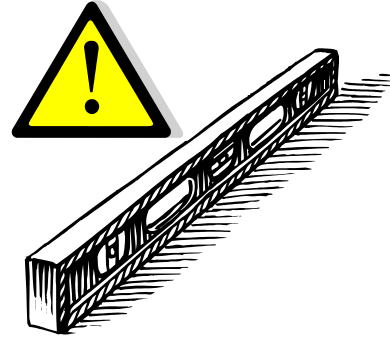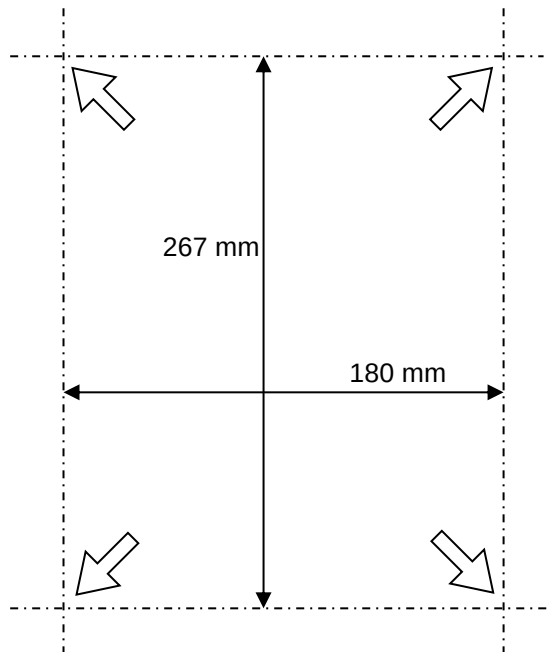

Connecting the energy meter to the panel over S-Bus, Anschliessen der Energie Zähler über S-Bus, Raccorder le compteur d'énergie au tableau via S-Bus :

Connect the S-Bus network to the S-Energy Manager panel as shown here.

Verbinden Sie das S-Bus-Netzwerk wie nachfolgend dargestellt mit dem S-Energy Manager Panel.

Reliez le réseau S-Bus avec le tableau S-Energy Manager comme illustré ci-dessous.

